

Design No. M525


August 18, 2020

Unrestrained Assembly Rating — 1 Hr.

Finish Rating — See Item 4

This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used — See Guide [BXUV](#) or [BXUV7](#)

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

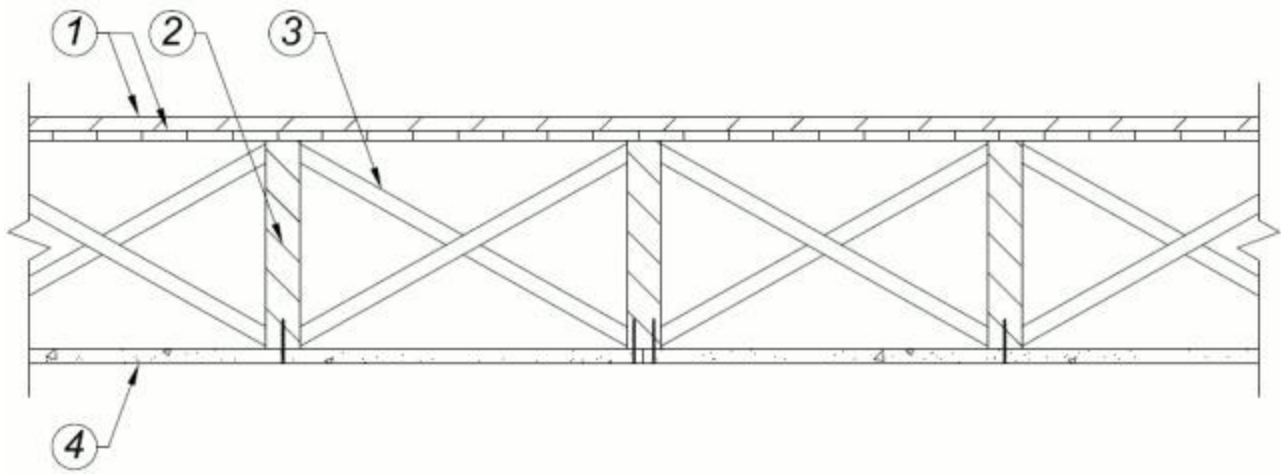

1. **Flooring Systems** — The flooring system shall consist of one of the following:

System No. 1

Subflooring — Min 1 by 6 in. T & G lumber fastened diagonally to joists, or min 15/32 in. thick plywood or min 7/16 in. thick oriented strand board (OSB) wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panel to be perpendicular to joists with joints staggered.

Vapor Barrier — Nom 0.010 in. thick commercial rosin-sized building paper.

Finish Flooring — Min 1 by 4 in. T & G lumber installed perpendicular to joists, or min 19/32 in. thick wood structural panels, min grade "Underlayment" or "Single-Floor". Face grain of plywood or strength axis of panels to be perpendicular to joists with joints staggered.

System No. 2

Subflooring — Nom 19/32 in. thick wood structural panels installed perpendicular to the joists with end joints staggered. Plywood or panels secured to joists with construction adhesive and No. 6d ringed shank nails, spaced 12 in. OC along each joist. Staples having equal or greater withdrawal and lateral resistance strength may be substituted for the 6d nails.

Vapor Barrier — (Optional) — Nom 0.010 in. thick commercial asphalt saturated felt.

Finish Flooring — Floor Topping Mixture* — Min 3/4 in. thickness of floor topping mixture having a minimum compressive strength of 1800 psi. Refer to manufacturer's instructions accompanying the material for specific mix design.

UNITED STATES GYPSUM CO — Types LRK, HSLRK, CSD

USG MEXICO S A DE C V — Types LRK, HSLRK, CSD

Floor Mat Materials* — (Optional) — Floor mat material loose laid over the subfloor. Refer to manufacturer's instructions regarding the minimum thickness of floor topping over each floor mat material.

UNITED STATES GYPSUM CO — Types SAM, LEVELROCK® Brand Sound Reduction Board, LEVELROCK® Brand Floor Underlayment SRM-25

System No. 3

Structural Cement-Fiber Units* — Nom 3/4 in. thick, with long edges tongue and grooved. Long dimension of panels to be perpendicular to joists with end joints staggered a min of 2 ft and centered over the joists. Panels secured to joists with 1-5/8 in. long No. 8 self-drilling, self-countersinking steel screws spaced a max of 12 in. OC in the field with a screw located 1 in. and 2 in. from each edge, and 8 in. OC on the perimeter with a screw located 2 in. from each edge, located 1/2 in. from the side edges of the panel.

UNITED STATES GYPSUM CO — Types STRUCTO-CRETE, USGSP

2. **Wood Joists** — Min 2 by 10, spaced 16 in. OC and effectively fire-blocked in accordance with local codes.

3. **Cross Bridging** — Min 1 by 3 in. or min 2 by 10 solid blocking.

3A. **Horizontal Bridging** — Used in lieu of Item 3 in same joist bay as ceiling damper (Item 6), when ceiling damper is employed. Wood 2 by 4 in. secured between joists with nails.

4. **Gypsum Board*** — Nom 5/8 in. thick, 48 in. wide gypsum board, installed with long dimension perpendicular to joists. For Direct Attachment - Gypsum board secured to joists with 2 in. long Type S steel screws spaced 6 in. OC with the last two screws located 1 and 3 in from each end of the board. For Attachment To Resilient/Furring Channels - Gypsum board screw-attached to the resilient/furring channels with 1 in. long Type S screws spaced 6 in. OC with the last two screws located 1 and 3 in from each end of the board. When **Steel Framing Members** (Item 8B or 8C) are used, the butt joints in the gypsum board shall be supported by two furring channels. The two furring channels shall be spaced approximately 3-1/2 in. OC, and be attached to underside of the joist with one RSIC-1, RSIC-1 (2.75) or Genie clip at each end of the channel.

CGC INC — Type ULIX (Finish Rating - 19 Min.)

UNITED STATES GYPSUM CO — Type ULIX (Finish Rating - 19 Min.)

4A. **Gypsum Board*** — (Not Shown) — For use with Items 8, 8B, 8C and 9A. Nom 5/8 in. thick, 48 in. wide gypsum board, installed with long dimension perpendicular to joists attached to resilient/furring channels - Gypsum board screw-attached to the resilient/furring channels with 1 in. long Type S screws spaced 8 in. OC, starting 1 in. from the side edges. At the end joints, the screws were located 3 in. from the edge. When **Steel Framing Members** (Item 8B or 8C) are used, the butt joints in the gypsum board shall be supported by two furring channels. The two furring channels shall be spaced approximately 3-1/2 in. OC, and be attached to underside of the joist with one RSIC-1, RSIC-1 (2.75) or Genie clip at each end of the channel.

CGC INC — Type ULIX (Finish Rating - 20 Min.)

UNITED STATES GYPSUM CO — Type ULIX (Finish Rating - 20 Min.)

4B. **Gypsum Board*** — For use when Steel Framing Members* (Item 8A) are used - One layer of 5/8 in. thick, 4 ft wide, installed with long dimension perpendicular to cross tees with side edges centered over main runners and joints centered over cross tees or channels. Fastened to cross tees or channels with 1 in. long Type S screws bugle-head screws spaced 8 in. OC with the screws located 4 in. from the midspan of the cross tee or channel, and 1-1/2 in. from side edges of gypsum panel. Fastened to main runners with 1 in. long Type S bugle-head screws spaced midway between cross tees or channels. End joints of gypsum panels shall be staggered not less than 4 ft OC with adjacent gypsum panels end joints.

CGC INC — Type ULIX (Finish Rating - 19 Min.)

UNITED STATES GYPSUM CO — Type ULIX (Finish Rating - 20 Min.)

5. **Finishing System** — (Not Shown) — Vinyl, dry or premixed joint compound, applied in two coats to joints and screw-heads. Nom 2 in. wide paper tape embedded in first layer of compound over all joints. As an alternate, nom 3/32 in. thick veneer plaster may be applied to the entire surface of gypsum board.

6. **Ceiling Damper*** — (Optional — Not Shown) — Max nom area shall be 198 sq in. Max rectangular size shall be 12 in. wide by 16-1/2 in. long. Max height of damper shall be 9-3/8 in. Aggregate damper openings shall not exceed 99 sq in. per 100 sq ft of ceiling area. Damper installed in accordance with the manufacturers installation instructions provided with the damper. A steel grille (Item 7) shall be installed in accordance with installation instructions.

RUSKIN COMPANY — Model CFD7

7. **Grille** — (Optional — Not Shown) — Steel grille, installed in accordance with the installation instructions provided with the ceiling damper.

8. **Resilient Channels** — (Optional — Not Shown) — Resilient channels formed of 25 MSG galv steel, installed perpendicular to the joists spaced max 16 in. OC. when glass fiber insulation is secured to the sub-floor with staples or to the wood joists with 0.090 in. diam galv steel wires (Item 9). When batt insulation (Item 9A) is draped over the resilient channel/gypsum board ceiling membrane (Item 4A), resilient channel spacing shall, also be max 16 in. OC. Channels secured to each joist with 2 in. long Type S steel screws. Screw length may be reduced to 1-5/8 in. when Item 4A is used. Channel splices located beneath joists and overlapped 4 in. Two channels, spaced 6 in. OC, oriented opposite each gypsum board end joint as shown in end joint detail. Additional channels shall extend min 6 in. beyond each side edge of board.

8A. **Alternate Steel Framing Members** — (Not Shown) — As an alternate to Item 8, main runners, cross tees, cross channels and wall angle as listed below.

a. **Main Runners** — Nom 10 or 12 ft long, 15/16 in. or 1-1/2 in. wide face, spaced 4 ft. OC. Main runners suspended by min 12 SWG galv steel hanger wires spaced 48 in. OC. Hanger wires to be located adjacent to main runner/cross tee intersections. Hanger wires wrapped and twist-tied on 16d nails driven in to side of joists at least 5 in. above the bottom face.

b. **Cross Tees** — Nom 4 ft long, 1-1/2 in. wide face, installed perpendicular to the main runners, spaced 16 in. OC. Additional cross tees or cross channels used at 8 in. from each side of butted gypsum panel end joints. The cross tees or cross channels may be riveted or screw attached to the wall angle or channel to facilitate the ceiling installation.

c. **Cross Channels** — Nom 4 or 12 ft long, installed perpendicular to main runners, spaced 16 in. OC. When Batts and Blankets (Item 9) are used, cross channels spaced 16 in. OC.

d. **Wall Angle or Channel** — Painted or galv steel angle with 1 in. legs or channel with 1 in. legs, 1-9/16 in. deep attached to walls at perimeter of ceiling with fasteners 16 in. OC. To support steel framing member ends and for screw-attachment of the gypsum panels.

CGC INC — Type DGL

USG INTERIORS LLC — Type DGL

8B. **Steel Framing Members*** — (Optional, Not Shown) — As an alternate to Item 8 — Furring channels and Steel Framing Members as described below:

a. **Furring Channels** — Formed of No. 25 MSG galv steel, 2-3/8 in. wide by 7/8 in. deep, installed perpendicular to the joists spaced max 16 in. OC when glass fiber insulation is secured to the sub-floor with staples or to the wood joists with 0.090 in. diam galv steel wires (Item 9). When batt insulation (Item 9A) is draped over the furring channel/gypsum board ceiling membrane (Item 4A), furring channel spacing shall be max 16 in. OC. Ends of adjoining channels overlapped 6 in. and tied together with double strand of No. 18 SWG galv steel wire near each end of overlap. Two channels, spaced 6 in. OC, oriented opposite each gypsum

board end joint as shown in end joint detail. Additional channels shall extend min 6 in. beyond each side edge of board.

b. **Steel Framing Members*** — Used to attach furring channels (Item a) to trusses (Item 2). Clips spaced 32 in. OC and secured to the bottom chord to alternating trusses with one No. 8 x 2-1/2 in. coarse drywall screw through center grommet. Furring channels are friction fitted into clips. Adjoining channels are overlapped as described in Item a. Additional clips required to hold furring channel that supports the gypsum board butt joints.

PLITEQ INC — Type Genie Clip

8C. **Alternate Steel Framing Members*** — (Optional, Not Shown) — For use with Items 4C and 9 or 9A. As an alternate to Items 8 to 8B, furring channels and Steel Framing Members as described below.

a. **Furring Channels** — Formed of No. 25 MSG galv steel. 2-9/16 in. or 2-23/32 in. wide by 7/8 in. deep, installed perpendicular to the joists spaced max 16 in. OC when glass fiber insulation is secured to the sub-floor with staples or to the wood joists with 0.09 in. diam galv steel wires (Item 9). When batt insulation (Item 9A) is draped over the furring channel/gypsum board ceiling membrane (Item 4C), furring channel spacing shall also be max 16 in. OC. Channels secured to joists as described in Item b. Ends of adjoining channels overlapped 6 in. and tied together with double strand of No. 18 SWG galv steel wire near each end of overlap.

b. **Steel Framing Members*** — Used to attach furring channels (Item a) to the wood joists (Item 2). Clips spaced a max of 48 in. OC. RSIC-1 and RSIC-1 (2.75) clips secured to alternating joists with No. 8 x 2-1/2 in. coarse drywall screw through the center grommet. Furring channels are friction fitted into clips. RSIC-1 clips for use with 2-9/16 in. wide furring channels. RSIC-1 (2.75) clips for use with 2-23/32 in. wide furring channels. Adjoining channels are overlapped as described in Item a. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping No. 6 framing screws, min. 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Additional clips required to hold furring channel that supports the wallboard butt joints, as described in Item 4C.

PAC INTERNATIONAL L L C — Types RSIC-1 or RSIC-1 (2.75)

8D. **Steel Framing Members*** — (Optional, Not Shown) — Used as an alternate method to attach resilient channels to structural members. A resilient sound isolation accessory shall be used at each attachment point of the resilient channels and spaced max 16 in. O.C. Channel ends butted and centered under the structural members and attached with one accessory at each end. Additional accessories used to hold resilient channels that support the gypsum board end joints. The accessory envelops the mounting edge of the resilient channel. The accessory and resilient channel are fastened to the structural members with the screws supplied with the accessory and per the accessory manufacturer's installation instructions.

PAC INTERNATIONAL L L C — Type RC-1 Boost

9. **Batts and Blankets*** — (Optional - Not Shown) — For Direct Attachment - Glass fiber insulation, secured to the subflooring with staples, or to the wood joists with 0.090 in. diam galv steel wires. Any thickness of glass fiber insulation bearing the UL Classification Marking as to Surface Burning Characteristics and/or Fire Resistance Batts.

See **Batts and Blankets (BKNV)** category in the Building Materials Directory for names of manufacturers.

9A. **Batts and Blankets*** — (Optional — Not Shown) — Not for Direct Attachment - For use with Item 4A. Any thickness of glass fiber insulation, nom. 0.5 pcf, fitted in the concealed space, draped over the resilient channels and gypsum board ceiling membrane (or Steel Framing Members/gypsum panel). Any glass fiber insulation bearing the UL Classification Marking for Surface Burning Characteristics having a flame spread index of 25 or less and a smoke developed index of 50 or less may be used.

See **Batts and Blankets (BKNV)** category in the Building Materials Directory for names of manufacturers.

10. **Discrete Products Installed in Air-handling Spaces*** — Automatic Balancing Valve/Damper — (Not Shown - Optional) — For use with item 6, Ruskin Company's Model CFD7 damper (CABS). Ceiling damper to be provided with plenum box per damper manufacturer's instructions with side outlet only. Entire assembly to be installed into any UL Class 0 or Class 1 flexible air duct in accordance with the instructions provided by the automatic balancing valve/damper manufacturer.

METAL INDUSTRIES INC — Model ABV-4, ABV-5, ABV-6

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

[Last Updated](#) on 2020-08-18